
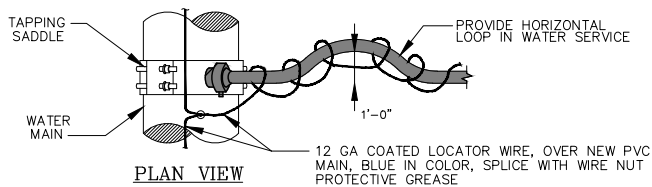


TYPICAL 1" WATER SERVICE CONNECTION

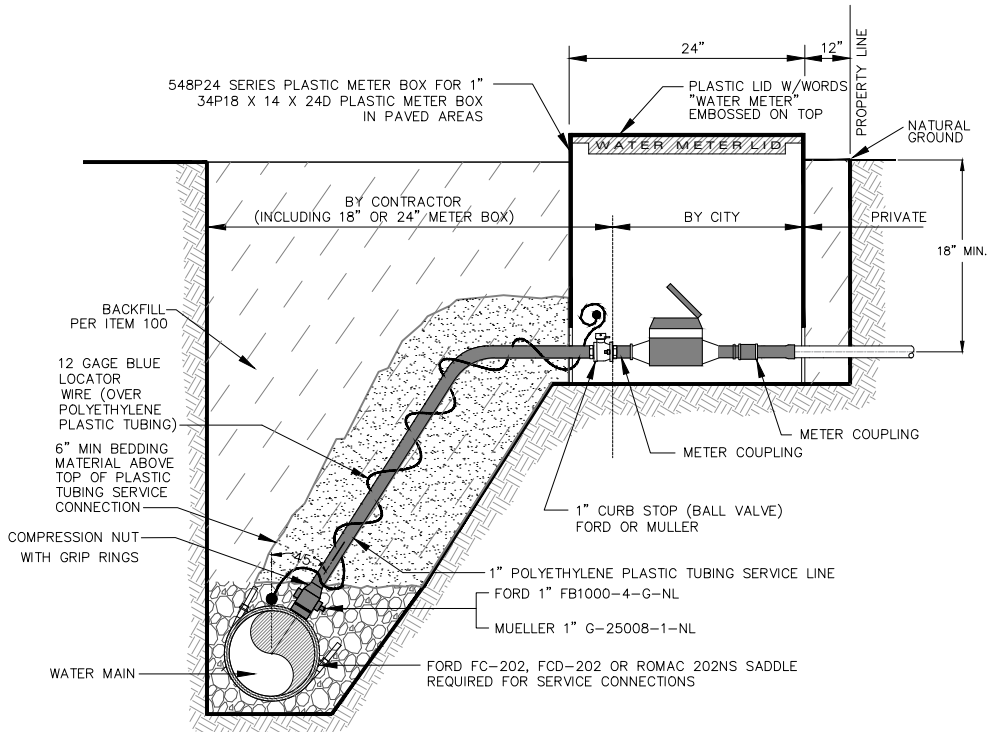

CONTRACTORS SHALL REPAIR / REPLACE CURB AND SIDEWALK AS NECESSARY FOR INSTALLATION OF SERVICES

NOTE:
 1. ALL BRASS GOODS MUST COMPLY TO AWWA SPECS. ON.C-800-55
 2. DO NOT CONNECT LOCATOR WIRE TO CORPORATION CHECK OR CURB STOP

GENERAL NOTES:

1. THE UTILITY CONTRACTOR IS TO INSTALL A NEW SERVICE LINE AT EACH INDIVIDUAL LOT OR TRACT. WATER SERVICE SHALL BE LOCATED 5' TO THE RIGHT OF THE CENTER LINE OF THE LOT WHEN VIEWED FROM THE MAIN.
2. THE SIZE OF THE SERVICE LINE IS TO BE AS NOTED ON THE PLAN SHEETS.
3. UPON COMPLETION OF THE SERVICE LINE, THE CONTRACTOR WILL LEAVE THE CORPORATION STOP OPEN AND THE CURB STOP CLOSED.
4. THE SERVICE LINE UP TO THE CURB STOP WILL BE INCLUDED IN THE STERILIZATION AND PRESSURE TESTING OF THE WATER MAIN.
5. THE BACKFILL AND CLEANUP REQUIREMENTS FOR SERVICE LINES ARE THE SAME AS ON WATER MAINS.
6. SERVICE CONNECTIONS SHALL NOT BE IN PAVED AREAS. BOXES SHOULD NOT BE IN TRAFFIC AREA UNLESS APPROVED BY THE CITY.

DRAWN BY: aOlivas/mS
 DATE: JULY 29, 2020
 SCALE: N.T.S.